


The water meter output should be a dry contact and should not pulse faster than 60 times a second (60 Hz).

A 22/12 AWG gauge cable no longer than 2000 feet (0.6 km) can be used to connect the water meter. Do not use a cable longer than 2000 feet even if a larger cable is used. DO NOT RUN THE METER CABLE OUTSIDE THE BUILDING!!

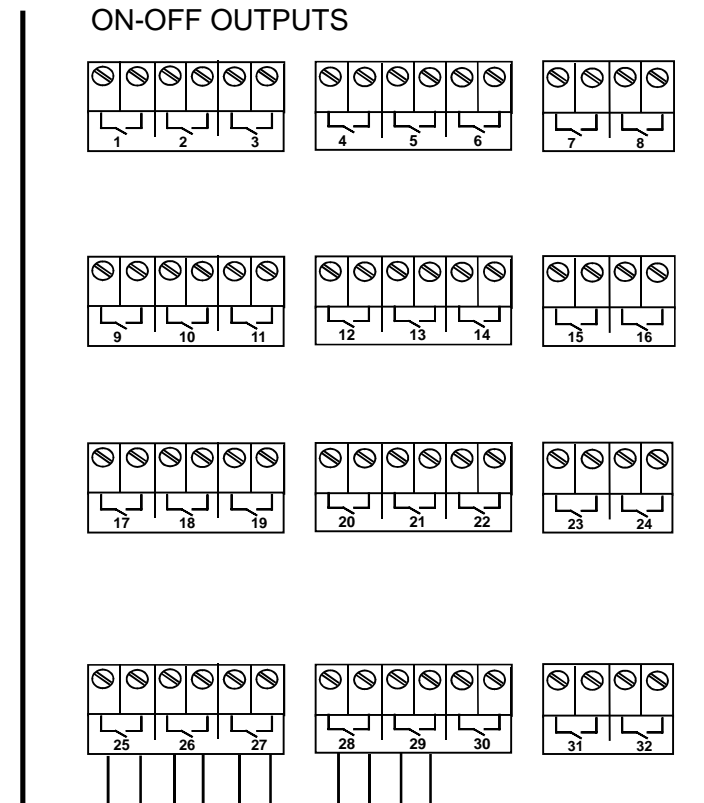


LEAVE A CLEARANCE OF AT LEAST 16" TO THE LEFT OF THE CONTROLLER BOX TO ALLOW THE COVER TO BE REMOVED FOR MAINTENANCE.

DRILL HOLES AT THE BOTTOM OF THE ENCLOSURE TO ALLOW WIRES TO BE INTRODUCED IN THE CONTROLLER. DO NOT DRILL THE TOP OR SIDE PANELS OF THE ENCLOSURE.

**WARNING**  
THE BACKUP THERMOSTAS SHOWN ARE FOR ILLUSTRATION PURPOSES ONLY. SUFFICIENT BACKUP THERMOSTATS MUST BE USED TO ENSURE VENTILATION IF THE RELAY PANEL LOSES POWER

FANS AND HEATERS ARE FOR ILLUSTRATION PURPOSES ONLY.

ALL LOAD SUPPLIES ARE:  
120-240 VAC, 50-60 HZ, 12-24 VDC

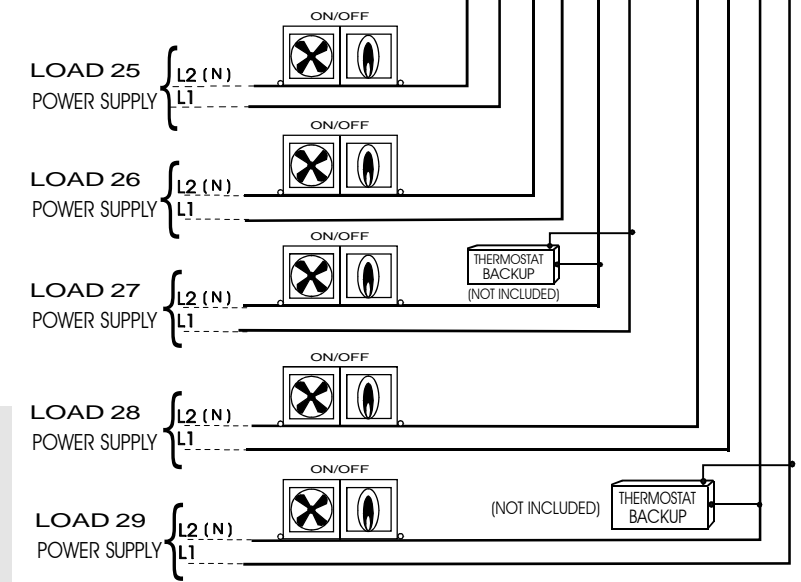

MAXIMUM LOAD RATINGS :  
MAX VOLTAGE = 270VAC OR 30VDC  
MAX MOTOR LOAD = 1HP AT 120 VAC, 2HP AT 240VAC  
MAX RESISTIVE LOAD CURRENT = 15A.